



**Geotechnical Investigation and Consultation Services**

**Proposed The Bornstedt Views Development Site**

**Tax Lot No. 100**

**SE Bornstedt Road and SE Averill Parkway**

**Sandy (Clackamas County), Oregon**

**for**

**Even Better Homes, Inc.**

**Project No. 1666.003.G  
May 3, 2021**

May 3, 2021

Mr. Mac Even  
Even Better Homes, Inc.  
P.O. Box 2021  
Gresham, Oregon 97030


Dear Mr. Even:

**Re: Geotechnical Investigation and Consultation Services,  
Proposed The Bornstedt Views Development Site, Tax Lot No. 100,  
SE Bornstedt Road and SE Averill Parkway, Sandy (Clackamas County), Oregon**

Submitted herewith is our report entitled "Geotechnical Investigation and Consultation Services, Proposed The Bornstedt Views Development Site, Tax Lot No. 100, SE Bornstedt Road and SE Averill Parkway, Sandy (Clackamas County), Oregon". The scope of our services was outlined in our formal proposal to Mr. Mac Even of Even Better Homes, Inc. dated July 10, 2020. Authorization of our services was provided by Mr. Mac Even on September 16, 2020.

During the course of our investigation, we have kept you and/or others advised of our schedule and preliminary findings. We appreciate the opportunity to assist you with this phase of the project. Should you have any questions regarding this report, please do not hesitate to call.

Sincerely,



Daniel M. Redmond, P.E., G.E.  
President/Principal Engineer

Cc: Mr. Ray Moore  
All County Surveyor's & Planners, Inc.



## TABLE OF CONTENTS

	Page No.
INTRODUCTION	1
PROJECT DESCRIPTION	1
SCOPE OF WORK	2
SITE CONDITIONS	3
Site Geology	3
Surface Conditions	3
Subsurface Soil Conditions	4
Groundwater	5
INFILTRATION TESTING	5
LABORATORY TESTING	5
SEISMICITY AND EARTHQUAKE SOURCES	6
Liquefaction	7
Landslides	7
Surface Rupture	7
Tsunami and Seiche	7
Flooding and Erosion	8
CONCLUSIONS AND RECOMMENDATIONS	8
General	8
Site Preparation	9
Foundation Support	10
Shallow Foundations	10
Floor Slab Support	11

## Table of Contents (continued)

Retaining/Below Grade Walls	11
Pavements	12
Collector Streets	13
Local Residential Street	13
Private Access Drives and Parking	14
Pavement Subgrade, Base Course & Asphalt Materials	14
Wet Weather Grading and Soft Spot Mitigation	15
Shrink-Swell and Frost Heave	15
Excavations/Slopes	15
Surface Drainage/Groundwater	16
Design Infiltration Rates	17
Seismic Design Considerations	17
CONSTRUCTION MONITORING AND TESTING	18
CLOSURE AND LIMITATIONS	18
LEVEL OF CARE	19
REFERENCES	20
ATTACHMENTS	
Figure No. 1 - Site Vicinity Map	
Figure No. 2 - Site Exploration Plan(s)	
Figure No. 3 - Typical Key and Bench Fill Slope Detail	
Figure No. 4 – Typical Perimeter Footing/Retaining Wall Drain Detail	
APPENDIX A	
Test Pit Logs and Laboratory Data	

**GEOTECHNICAL INVESTIGATION AND CONSULTATION SERVICES  
PROPOSED THE BORNSTEDT VIEWS DEVELOPMENT SITE  
TAX LOT NO. 100  
SE BORNSTEDT ROAD AND SE AVERILL PARKWAY  
SANDY (CLACKAMAS COUNTY) OREGON**


**INTRODUCTION**

Redmond Geotechnical Services, LLC is please to submit to you the results of our Geotechnical Investigation and Consultation Services at the site of the proposed new The Bornstedt Views residential development project located to the east of SE Bornstedt Road and to the west of SE Averill Parkway in Sandy (Clackamas County), Oregon. The general location of the subject site is shown on the Site Vicinity Map, Figure No. 1. The purpose of our geotechnical investigation and consultation services at this time was to explore the existing subsurface soils and/or groundwater conditions across the subject site and to evaluate any potential concerns with regard to development at the site as well as to develop and/or provide appropriate geotechnical design and construction recommendations for the proposed new The Bornstedt Views residential development project.

**PROJECT DESCRIPTION**

Based on a review of the proposed site development plans, we understand that present plans will consist of the construction of a new residential subdivision development. Reportedly, the project will consist of the development and/or construction of approximately four-two (42) new single-family residential home sites and/or lots ranging in size from about 7,500 to 12,000 square feet. We understand that the lots will primarily be developed with new two-story wood-frame residential structures.


Support of the new single-family residential structures is anticipated to consist primarily of conventional shallow strip (continuous) footings although some individual (column) footings will also be required. Additionally, we envision that the proposed new single-family residential structures will likely be constructed with raised wooden post and beams floors although some concrete slab-on-grade floors are also possible. Further, due to the sloping site grades, we anticipate that some of the proposed new residential homes and/or structures may be constructed with partial and/or below levels. As such, construction of some below grade retaining walls is also anticipated form the project. Structural loading information, although unavailable at this time, is anticipated to be fairly typical for this type of two-story wood-frame structure and is expected to result in maximum dead plus live continuous (strip) and individual (column) footing loads on the order of about 2.0 to 3.5 kips per lineal foot (klf) and 10 to 35 kips, respectively.

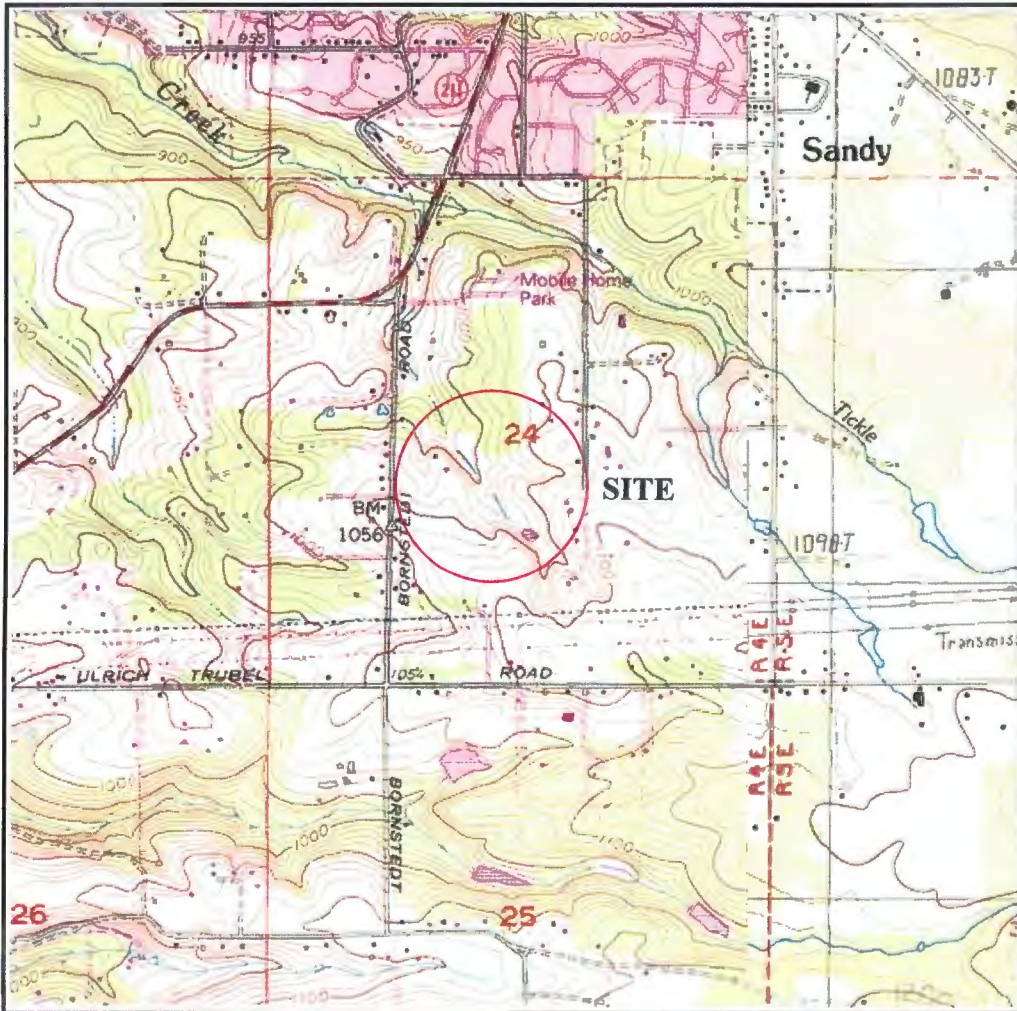

**SANDY QUADRANGLE  
OREGON**

**7.5-MINUTE SERIES**

**SCALE 1:24 000**

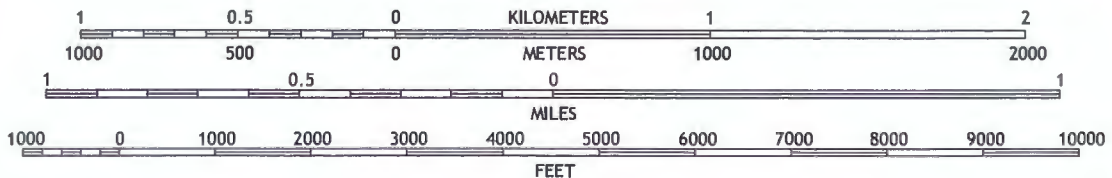

CONTOUR INTERVAL 40 FEET  
NORTH AMERICAN VERTICAL DATUM OF 1988

**SITE VICINITY MAP**

**THE BORNSTEDT VIEWS  
TL 100, SE BORNSTEDT ROAD**

Project No. 1666.003.G

Figure No. 1

Other associated site improvements for the project will include construction of new paved public streets and/or private access drives and parking areas. Additionally, the project will include the construction of new underground utility services as well as new concrete curbs and sidewalks. Further, we understand that development of the site will also include the collection of storm water from hard and/or impervious surfaces (i.e., roofs and pavements) for on-site treatment and disposal within various storm water detention facilities designed by the Civil Engineer.

Earthwork and grading operations for the project to bring the subject property to finish design grades and/or elevations will reportedly result in both cuts and/or fills. A review of the proposed site grading plans for the project indicate that cuts and/or fills of between five (5) and ten (10) feet are generally anticipated across the site.

### **SCOPE OF WORK**

The purpose of our geotechnical studies was to evaluate the overall subsurface soil and/or groundwater conditions underlying the subject site with regard to the proposed new The Bornstedt Views residential development and construction at the site and any associated impacts or concerns with respect to development at the site as well as provide appropriate geotechnical design and construction recommendations for the project. Specifically, our geotechnical investigation included the following scope of work items:

1. Review of available and relevant geologic and/or geotechnical investigation reports for the subject site and/or area.
2. A detailed field reconnaissance and subsurface exploration program of the soil and ground water conditions underlying the site by means of ten (10) exploratory test pit excavations. The exploratory test pits were excavated to depths ranging from about five (5) to seven (7) feet beneath existing site grades at the approximate locations as shown on the Site Exploration Plan, Figure No. 2. Additionally, field infiltration testing was also performed within various test pits excavated across the subject site.
3. Laboratory testing to evaluate and identify pertinent physical and engineering properties of the subsurface soils encountered relative to the planned site development and construction at the site. The laboratory testing program included tests to help evaluate the natural (field) moisture content and dry density, maximum dry density and optimum moisture content, Atterberg Limits and gradational characteristics as well as direct shear strength and "R"-value tests.
4. A literature review and engineering evaluation and assessment of the regional seismicity to evaluate the potential ground motion hazard(s) at the subject site. The evaluation and assessment included a review of the regional earthquake history and sources such as potential seismic sources, maximum credible earthquakes, and reoccurrence intervals as well as a discussion of the possible ground response to the selected design earthquake(s), fault rupture, landsliding, liquefaction, and tsunami and seiche flooding.

5. Engineering analyses utilizing the field and laboratory data as a basis for furnishing recommendations for foundation support of the proposed new residential structures. Recommendations include maximum design allowable contact bearing pressure(s), depth of footing embedment, estimates of foundation settlement, lateral soil resistance, and foundation subgrade preparation. Additionally, construction and/or permanent subsurface water drainage considerations have also been prepared. Further, our report includes recommendations regarding site preparation, placement and compaction of structural fill materials, suitability of the on-site soils for use as structural fill, criteria for import fill materials, and preparation of foundation, pavement and/or floor slab subgrades.
6. Flexible pavement design and construction recommendations for the proposed new public streets and private access drives and parking area improvements.

## **SITE CONDITIONS**

### **Regional and Site Geology**

The subject site and/or area is located on the eastern margin of the Portland Basin near where the basin meets the western edge of the Cascade Mountains physiographic province (Orr and Orr, 1999). Bedrock in this region consists of volcanic rocks emplaced tens of millions of years ago, associated with the Columbia River Basalt Group and with volcanics from the Western Cascades province (Gannet and Caldwell, 1998).

The volcanic basement is overlain by silts, sands and gravels of Miocene to Pleistocene age which form the majority of the basin fill in the area. The basin fill sediments generally are mapped as Sandy River Mudstone towards the lower portion of the assemblage in turn overlain by the Troutdale Formation, a series of gravels, sands and silts deposited by the ancestral Columbia River and smaller rivers flowing from the Cascade Mountains (Schlicker and Finlayson, 1979). In the vicinity of Sandy, the Troutdale Formation is overlain by the Springwater Formation, a conglomerate with some volcanoclastic sands, silts, and debris flows derived from the Cascade Range. The conglomerate consists of gravels, cobbles, and boulders of volcanic composition that are strongly and deeply weathered to completely decomposed residual soils often producing a red, fine-grained soil up to 75 feet deep.

### **Surface Conditions**

The proposed new The Bornstedt Views residential development property consists of one (1) generally rectangular shaped tax lot (TL 100) which encompass a total plan area of approximately 12.74 acres. The proposed The Bornstedt Views residential development property is roughly located to the east of SE Bornstedt Road and to the west of SE Averill Parkway. The subject property is presently improved and contains an existing single-family residential home as well as various detached wooden outbuildings.



Surface vegetation across the site generally consists of a light to moderate growth of grass, weeds and brush as well as numerous small to large sized trees. Additionally, the central portion of the subject property contains an existing seasonal drainage basin and/or tributary to Tickle Creek.

Topographically, the subject site is generally characterized as gently sloping terrain (i.e., 5 to 10 percent) descending downwards from the east and the west towards the central portion of the site associated with the seasonal tributary of Tickle Creek. Overall topographic relief across the entire site estimated at about sixty-eight (68) feet and ranges from a low about Elevation 978 feet near the northerly end of the existing seasonal drainage basin to a high of about Elevation 1046 near the easterly portion of the site.


### **Subsurface Soil Conditions**

Our understanding of the subsurface soil conditions underlying the site was developed by means of ten (10) exploratory test pits excavated to depths ranging from about five (5) to seven (7) feet beneath existing site grades on October 1, 2020 with portable Geoprobe equipment. The location of the exploratory test pits were located in the field by marking off distances from existing and/or known site features and are shown in relation to the existing site features and/or site improvements on the Site Exploration Plan, Figure No. 2. Detailed logs of the test pit explorations, presenting conditions encountered at each location explored, are presented in the Appendix, Figure No's. A-4 through A-8.

The exploratory test pit excavations were observed by staff from Redmond Geotechnical Services, LLC who logged each of the test pit explorations and obtained representative samples of the subsurface soils encountered across the site. Additionally, the elevation of the exploratory test pit excavations were referenced from a site topographic survey prepared by All County Surveyor's & Planners, Inc. and should be considered as approximate. All subsurface soils encountered at the site and/or within the exploratory test pit excavations were logged and classified in general conformance with the Unified Soil Classification System (USCS) which is outlined on Figure No. A-3.

The test pit explorations revealed that the subject site is underlain by native soil deposits comprised of residual soils and/or highly weathered bedrock deposits composed of a surficial layer of dark brown, wet, soft, organic, sandy, clayey silt topsoil materials to depths of about 12 to 14 inches. These surficial topsoil materials were inturn underlain by residual soils composed of reddish-brown, very moist to wet, soft to medium stiff, sandy, clayey silt to silty clay to depths of about four (4) to six (6) feet beneath the existing site and/or surface grades. These clayey silt to silty clay soils are best characterized by relatively low to moderate strength and moderate compressibility. These upper residual soils were inturn underlain by light reddish- to orangish-brown, very moist, very stiff to dense, sandy, clayey silt to highly weathered bedrock deposits to the maximum depth explored of about seven (7) feet beneath the existing site and/or surface grades. These sandy, clayey silt to highly weathered bedrock deposits are best characterized by relatively moderate strength and low to moderate compressibility.

SITE EXPLORATION PLAN

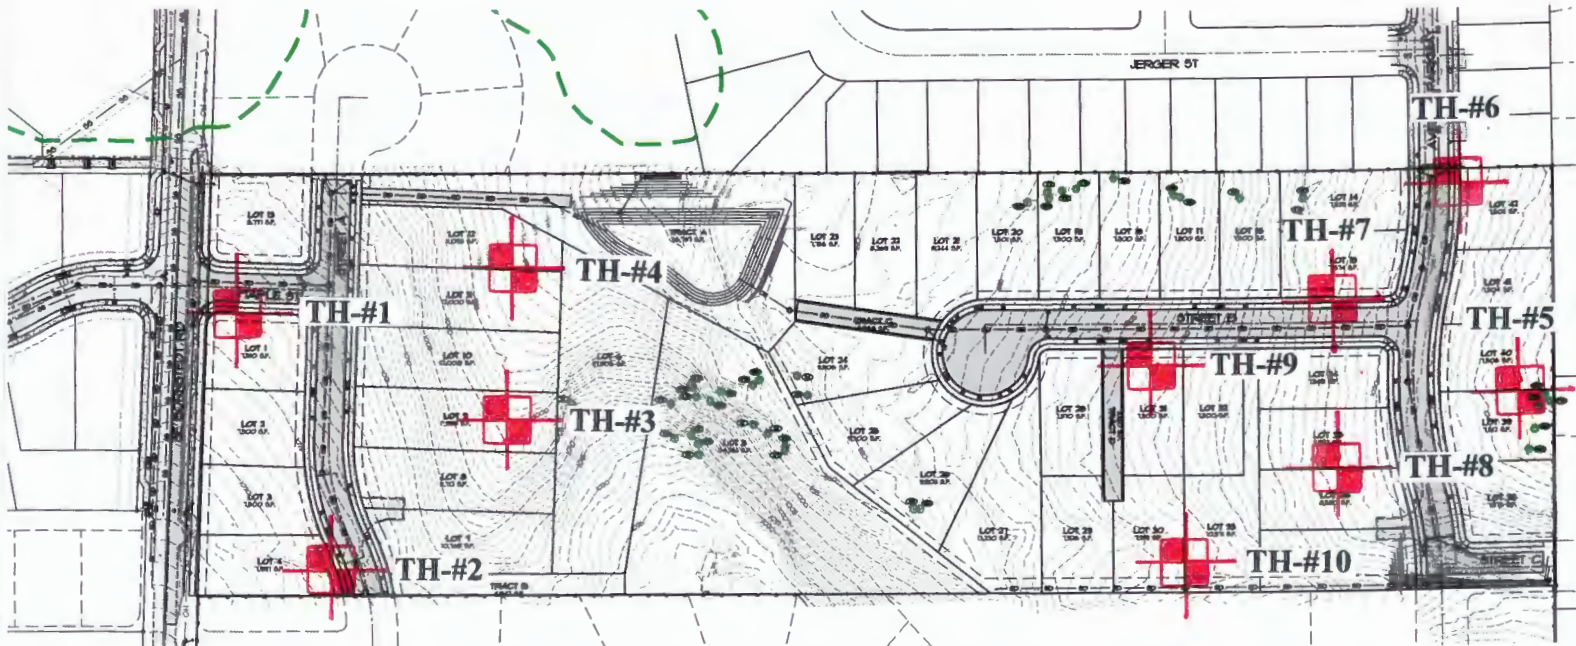

**TH-#10** LEGEND Indicates approximate location of exploratory test hole



## **Groundwater**

Groundwater was not encountered within any of the exploratory test pit explorations (TH-#1 through TH-#10) at the time of excavation to depths of at least 7.0 feet beneath existing surface grades except. However, the central portion of the subject property contains an existing seasonal drainage basin.

In this regard, groundwater elevations at the site may fluctuate seasonally in accordance with rainfall conditions and/or associated with runoff across the site as well as changes in site utilization. As such, we are generally of the opinion that the static water levels and/or surface water ponding observed and/or not observed during our recent field exploration work generally reflect the seasonal groundwater level(s) at and/or beneath the site.

## **INFILTRATION TESTING**

We performed two (2) field infiltration tests at the site on October 1, 2020. The infiltration tests were performed in test holes TH-#4 and TH-#10 at depths of between four (4) and five (5) feet beneath the existing site and/or surface grades. The subgrade soils encountered in the infiltration test hole consisted of sandy, clayey silt to silty clay. The infiltration testing was performed in general conformance with current EPA and/or the City of Sandy/Clackamas County Encased Falling Head test method which consisted of advancing a 6-inch diameter PVC pipe approximately 6 inches into the exposed soil horizon at each test location. Using a steady water flow, water was discharged into the pipe and allowed to penetrate and saturate the subgrade soils. The water level was adjusted over a two (2) hour period and allowed to achieve a saturated subgrade soil condition consistent with the bottom elevation of the surrounding test pit excavation. Following the required saturating period, water was again added into the PVC pipe and the time and/or rate at which the water level dropped was monitored and recorded. Each measurable drop in the water level was recorded until a consistent infiltration rate was observed and/or repeated.

Based on the results of the field infiltration testing at the site, we have found that the native sandy, clayey silt subgrade soil deposits possess an ultimate infiltration rate on the order of about 0.1 to 0.2 inches per hour (in/hr).

## **LABORATORY TESTING**

Representative samples of the on-site subsurface soils were collected at selected depths and intervals from various test pit excavations and returned to our laboratory for further examination and testing and/or to aid in the classification of the subsurface soils as well as to help evaluate and identify their engineering strength and compressibility characteristics. The laboratory testing consisted of visual and textural sample inspection, moisture content and dry density determinations, maximum dry density and optimum moisture content, Atterberg Limits and gradation analyses as well as direct shear strength and "R"-value tests. Results of the various laboratory tests are presented in the Appendix, Figure No's. A-9 through A-13.

## **SEISMICITY AND EARTHQUAKE SOURCES**

The seismicity of the southwest Washington and northwest Oregon area, and hence the potential for ground shaking, is controlled by three separate fault mechanisms. These include the Cascadia Subduction Zone (CSZ), the mid-depth intraplate zone, and the relatively shallow crustal zone. Descriptions of these potential earthquake sources are presented below.

The CSZ is located offshore and extends from northern California to British Columbia. Within this zone, the oceanic Juan de Fuca Plate is being subducted beneath the continental North American Plate to the east. The interface between these two plates is located at a depth of approximately 15 to 20 kilometers (km). The seismicity of the CSZ is subject to several uncertainties, including the maximum earthquake magnitude and the recurrence intervals associated with various magnitude earthquakes. Anecdotal evidence of previous CSZ earthquakes has been observed within coastal marshes along the Washington and Oregon coastlines. Sequences of interlayered peat and sands have been interpreted to be the result of large Subduction zone earthquakes occurring at intervals on the order of 300 to 500 years, with the most recent event taking place approximately 300 years ago. A study by Geomatrix (1995) and/or USGS (2008) suggests that the maximum earthquake associated with the CSZ is moment magnitude ( $M_w$ ) 8 to 9. This is based on an empirical expression relating moment magnitude to the area of fault rupture derived from earthquakes that have occurred within Subduction zones in other parts of the world. An  $M_w$  9 earthquake would involve a rupture of the entire CSZ. As discussed by Geomatrix (1995) this has not occurred in other subduction zones that have exhibited much higher levels of historical seismicity than the CSZ. However, the 2008 USGS report has assigned a probability of 0.67 for a  $M_w$  9 earthquake and a probability of 0.33 for a  $M_w$  8.3 earthquake. For the purpose of this study an earthquake of  $M_w$  9.0 was assumed to occur within the CSZ.

The intraplate zone encompasses the portion of the subducting Juan de Fuca Plate located at a depth of approximately 30 to 50 km below western Washington and western Oregon. Very low levels of seismicity have been observed within the intraplate zone in western Oregon and western Washington. However, much higher levels of seismicity within this zone have been recorded in Washington and California. Several reasons for this seismic quiescence were suggested in the Geomatrix (1995) study and include changes in the direction of Subduction between Oregon, Washington, and British Columbia as well as the effects of volcanic activity along the Cascade Range. Historical activity associated with the intraplate zone includes the 1949 Olympia magnitude 7.1 and the 1965 Puget Sound magnitude 6.5 earthquakes. Based on the data presented within the Geomatrix (1995) report, an earthquake of magnitude 7.25 has been chosen to represent the seismic potential of the intraplate zone.

The third source of seismicity that can result in ground shaking within the Vancouver and southwest Washington area is near-surface crustal earthquakes occurring within the North American Plate. The historical seismicity of crustal earthquakes in this area is higher than the seismicity associated with the CSZ and the intraplate zone. The 1993 Scotts Mills (magnitude 5.6) and Klamath Falls (magnitude 6.0), Oregon earthquakes were crustal earthquakes.

### **Liquefaction**

Seismic induced soil liquefaction is a phenomenon in which loose, granular soils and some silty soils, located below the water table, develop high pore water pressures and lose strength due to ground vibrations induced by earthquakes. Soil liquefaction can result in lateral flow of material into river channels, ground settlements and increased lateral and uplift pressures on underground structures. Buildings supported on soils that have liquefied often settle and tilt and may displace laterally. Soils located above the ground water table cannot liquefy, but granular soils located above the water table may settle during the earthquake shaking.

Our review of the subsurface soil test pit logs from our exploratory field explorations (TH-#1 through TH-#10) and laboratory test results indicate that the site is generally underlain by medium stiff to very stiff, sandy, clayey silt to silty clay and/or dense highly weathered bedrock deposits to depths of at least 7.0 feet beneath existing site grades. Additionally, groundwater was generally not encountered within any of the exploratory test pit excavations (TH-#1 through TH-#10) at the site during our field exploration work.

As such, due to the medium stiff to very stiff and/or cohesive nature of the sandy, clayey silt to silty clay subgrade soils and/or dense, highly weathered bedrock deposits beneath the site, it is our opinion that the native clayey, sandy silt to silty clay subgrade soil and/or highly weathered bedrock deposits located beneath the subject site have a very low potential for liquefaction during the design earthquake motions previously described.

### **Landslides**

No ancient and/or active landslides were observed or are known to be present on the subject site. Additionally, the subject property does not contain any steep slopes (i.e., greater than 40 percent). As such, development of the subject site into the planned residential development does not appear to present a potential geologic and/or landslide hazard provided that the site grading and development activities conform with the recommendations presented within this report.

### **Surface Rupture**

Although the site is generally located within a region of the country known for seismic activity, no known faults exist on and/or immediately adjacent to the subject site. As such, the risk of surface rupture due to faulting is considered negligible.

### **Tsunami and Seiche**

A tsunami, or seismic sea wave, is produced when a major fault under the ocean floor moves vertically and shifts the water column above it. A seiche is a periodic oscillation of a body of water resulting in changing water levels, sometimes caused by an earthquake. Tsunami and seiche are not considered a potential hazard at this site because the site is not near to the coast and/or there are no adjacent significant bodies of water.

### **Flooding and Erosion**

Stream flooding is a potential hazard that should be considered in lowland areas of Clackamas County and Sandy. The FEMA (Federal Emergency Management Agency) flood maps should be reviewed as part of the design for the proposed new residential structures and site improvements. Elevations of structures on the site should be designed based upon consultants reports, FEMA (Federal Emergency Management Agency), and Clackamas County requirements for the 100-year flood levels of any nearby creeks, streams and/or drainage basins.

### **CONCLUSIONS AND RECOMMENDATIONS**

#### **General**

Based on the results of our field explorations, laboratory testing, and engineering analyses, it is our opinion that the site is presently stable and suitable for the proposed new The Bornstedt Views residential development and its associated site improvements provided that the recommendations contained within this report are properly incorporated into the design and construction of the The Bornstedt Views residential development project.

The primary features of concern at the site are 1) the presence of highly moisture sensitive clayey and silty subgrade soils across the site, 2) the presence of gently to moderately steep sloping site conditions across the site and 3) the relatively low infiltration rates anticipated within the near surface clayey and silty clay subgrade soils.

With regard to the moisture sensitive clayey and silty subgrade soils, we are generally of the opinion that all site grading and earthwork activities be scheduled for the drier summer months which is typically June through September. In regards to the gently to moderately steep sloping site conditions across the site, we are of the opinion that site grading and/or structural fill placement should be minimized where possible and should generally limit cuts and/or fills to about ten (10) feet unless approved by the Geotechnical Engineer. Additionally, where existing site slopes and/or surface grades exceed about 20 percent (1V:5H) and in order to construct the proposed new site improvements, benching and keying of all fills into the natural site slopes will be required. Further, due to the presence of the existing seasonal drainage basins at the site, the use of subdrains will be required beneath all structural fills above existing slopes which exceed about 20 percent. In addition to the above, we recommend that each lot which borders the easterly moderately steep slope (Lots 1 through 12) engage a Geotechnical Engineer to provide site specific design and construction recommendations for the proposed single-family residential structures. With regard to the relatively low infiltration rates anticipated within the clayey and silty subgrade soils beneath the site, we generally do not recommend any storm water detention and/or infiltration within structural and/or embankment fills. However, storm water detention and some infiltration may be feasible within storm water detention basins excavated into the existing medium stiff, sandy, clayey silt ro silty clayey residual soils. In this regard, we recommend that all proposed storm water detention and/or infiltration systems for the project be reviewed and approved by Redmond Geotechnical Services, LLC.

The following sections of this report provide specific recommendations regarding subgrade preparation and grading as well as foundation and floor slab design and construction for the new The Bornstedt Views residential development project.

### **Site Preparation**

As an initial step in site preparation, we recommend that the proposed new The Bornstedt Views residential development site as well as any associated structural and/or site improvement area(s) be stripped and cleared of all existing improvements, any existing unsuitable fill materials, surface debris, existing vegetation, topsoil materials, and/or any other deleterious materials present at the time of construction. In general, we envision that the site stripping to remove existing vegetation and topsoil materials will generally be about 12 inches. However, localized areas requiring deeper removals, such as any existing undocumented and/or unsuitable fill materials as well as old foundation remnants, will likely be encountered and should be evaluated at the time of construction by the Geotechnical Engineer. The stripped and cleared materials should be properly disposed of as they are generally considered unsuitable for use/reuse as fill materials.

Following the completion of the site stripping and clearing work and prior to the placement of any required structural fill materials and/or structural improvements, the exposed subgrade soils within the planned structural improvement area(s) should be inspected and approved by the Geotechnical Engineer and possibly proof-rolled with a half and/or fully loaded dump truck. Areas found to be soft or otherwise unsuitable should be over-excavated and removed or scarified and recompacted as structural fill. During wet and/or inclement weather conditions, proof rolling and/or scarification and recompaction as noted above may not be appropriate.

The on-site native sandy, clayey silt subgrade soil materials are generally considered suitable for use/reuse as structural fill materials provided that they are free of organic materials, debris, and rock fragments in excess of about 6 inches in dimension. However, if site grading is performed during wet or inclement weather conditions, the use of some of the on-site native soil materials which contain significant silt and clay sized particles will be difficult at best. In this regard, during wet or inclement weather conditions, we recommend that an import structural fill material be utilized which should consist of a free-draining (clean) granular fill (sand & gravel) containing no more than about 5 percent fines. Representative samples of the materials which are to be used as structural fill materials should be submitted to the Geotechnical Engineer and/or laboratory for approval and determination of the maximum dry density and optimum moisture content for compaction.

In general, all site earthwork and grading activities should be scheduled for the drier summer months (June through September) if possible. However, if wet weather site preparation and grading is required, it is generally recommended that the stripping of topsoil materials be accomplished with a tracked excavator utilizing a large smooth-toothed bucket working from areas yet to be excavated. Additionally, the loading of strippings into trucks and/or protection of moisture sensitive subgrade soils will also be required during wet weather grading and construction.

In this regard, we recommend that areas in which construction equipment will be traveling be protected by covering the exposed subgrade soils with a geotextile fabric such as Mirafi FW404 followed by at least 12 inches or more of crushed aggregate base rock. Further, the geotextile fabric should have a minimum Mullen burst strength of at least 250 pounds per square inch for puncture resistance and an apparent opening size (AOS) between the U.S. Standard No. 70 and No. 100 sieves.

All structural fill materials placed within the new building and/or pavement areas should be moistened or dried as necessary to near (within 3 percent) optimum moisture conditions and compacted by mechanical means to a minimum of 92 percent of the maximum dry density as determined by the ASTM D-1557 (AASHTO T-180) test procedures. Structural fill materials should be placed in lifts (layers) such that when compacted do not exceed about 8 inches. Additionally, all fill materials placed within five (5) lineal feet of the perimeter (limits) of the proposed single-family structures and/or pavements should be considered structural fill. Additionally, due to the sloping site conditions, we recommend that all structural fill materials planned in areas where existing surface and/or slope gradients exceed about 20 percent (1V:5H) be properly benched and/or keyed into the native (natural) slope subgrade soils. In general, a bench width of about eight (8) to ten (10) feet and a keyway depth of about one (1) to one and one-half (1.5) feet is recommended (see Typical Key and Bench Fill Slope Detail, Figure No. 3).

However, the actual bench width and keyway depth should be determined at the time of construction by the Geotechnical Engineer. Further, all fill slopes should be constructed with a finish slope surface gradient no steeper than about 2H:1V. All aspects of the site grading, including a review of the proposed site grading plan(s), should be approved and/or monitored by a representative of Redmond Geotechnical Services, LLC.


### **Foundation Support**

Based on the results of our investigation, it is our opinion that the site of the proposed new The Bornstedt Views residential development is suitable for support of the planned two-story wood-frame structures provided that the following foundation design recommendations are followed. The following sections of this report present specific foundation design and construction recommendations for the planned new single-family residential structures.

#### **Shallow Foundations**

In general, conventional shallow continuous (strip) footings and individual (spread) column footings may be supported by approved native (untreated) subgrade soil materials and/or clayey silt structural fill soils based on an allowable contact bearing pressure of about 2,000 pounds per square foot (psf). This recommended allowable contact bearing pressure is intended for dead loads and sustained live loads and may be increased by one-third for the total of all loads including short-term wind or seismic loads. In general, continuous strip footings should have a minimum width of at least 16 inches and be embedded at least 18 inches below the lowest adjacent finish grade (includes frost protection).



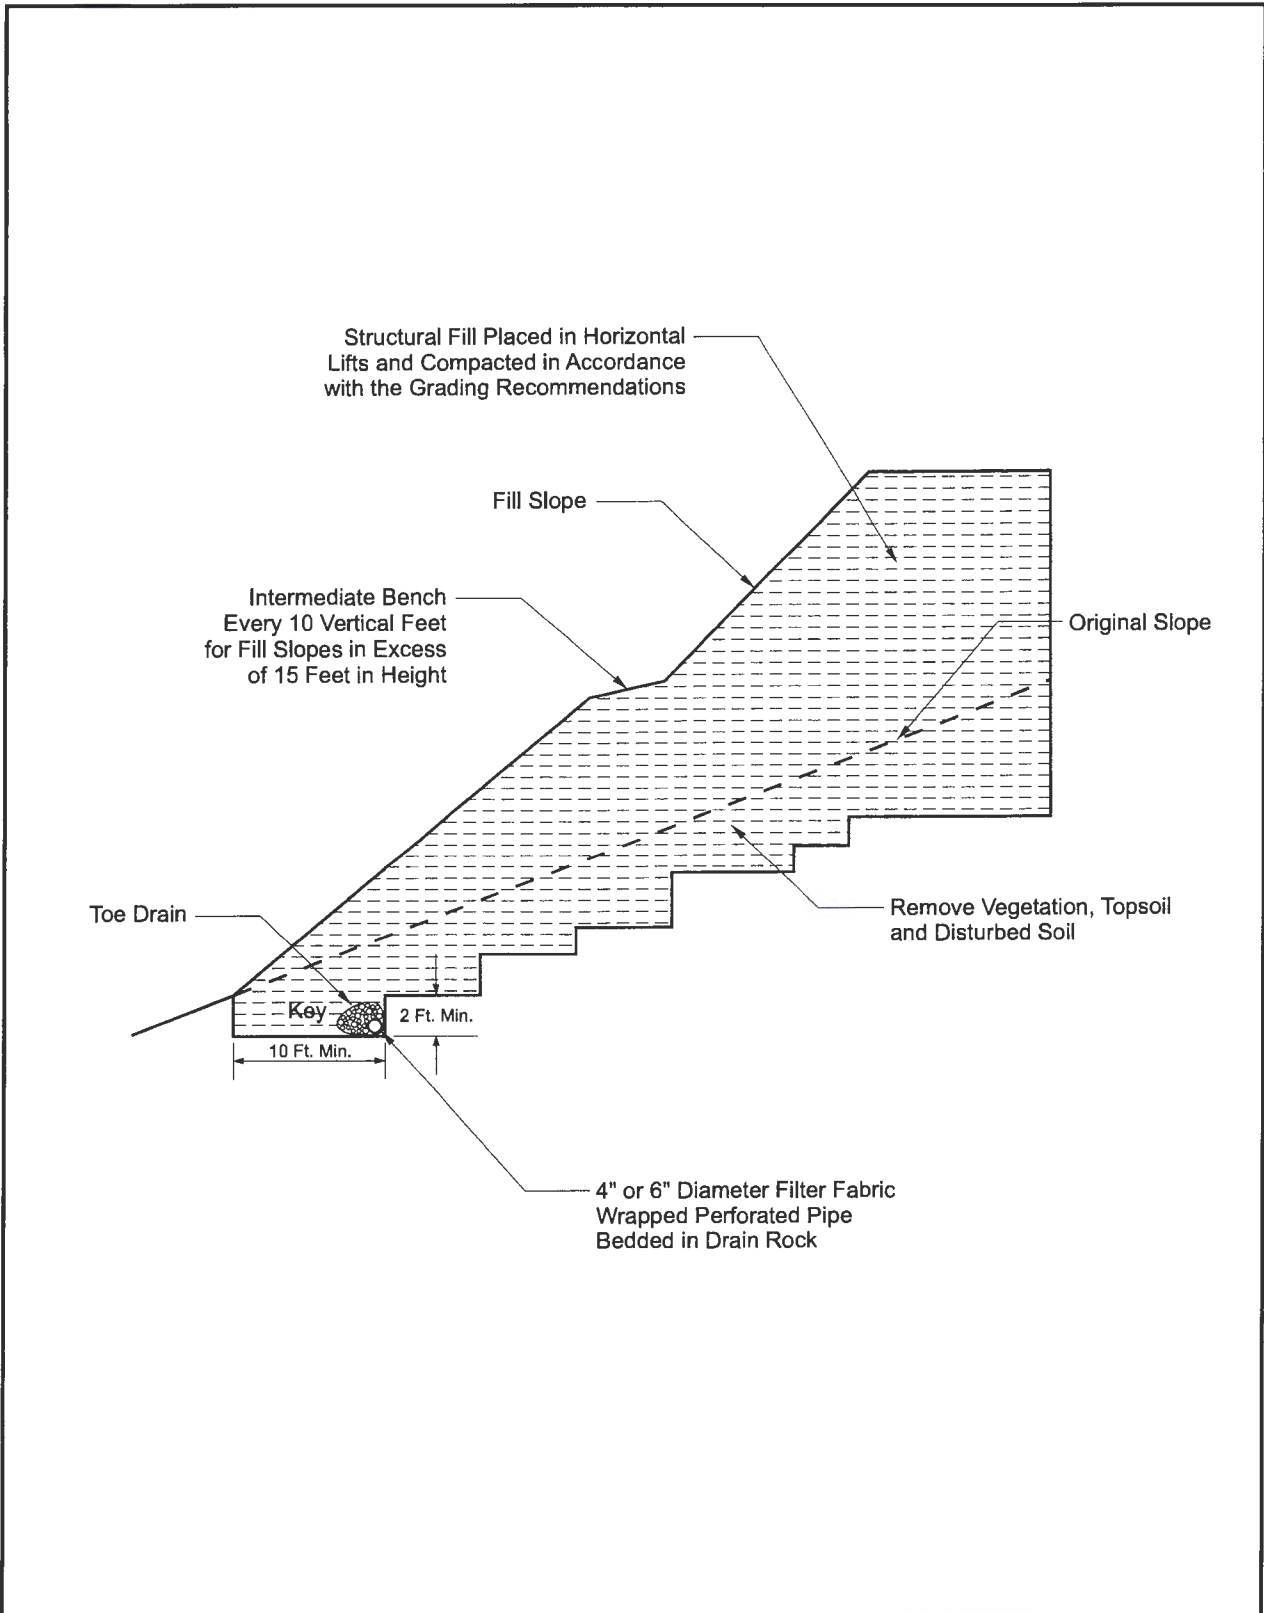

**TYPICAL BENCH AND KEY FILL SLOPE DETAIL**

Project No. 1666.003.G

**THE BORNSTEDT VIEWS  
TL 100, SE BORNSTEDT ROAD**

Figure No. 3

Individual column footings (where required) should be embedded at least 18 inches below grade and have a minimum width of at least 24 inches. Additionally, if foundation excavation and construction work is planned to be performed during wet and/or inclement weather conditions, we recommend that a 2- to 4-inch layer of compacted crushed rock be used to help protect the exposed foundation bearing surfaces until the placement of concrete.

Total and differential settlements of foundations constructed as recommended above and supported by approved native subgrade soils or by properly compacted structural fill materials are expected to be well within the tolerable limits for this type of wood-frame structure and should generally be less than about 1-inch and 1/2-inch, respectively.

Allowable lateral frictional resistance between the base of the footing element and the supporting subgrade bearing soil can be expressed as the applied vertical load multiplied by a coefficient of friction of 0.30 and 0.45 for native silty subgrade soils and/or import gravel fill materials, respectively. In addition, lateral loads may be resisted by passive earth pressures on footings poured "neat" against in-situ (native) subgrade soils or properly backfilled with structural fill materials based on an equivalent fluid density of 250 pounds per cubic foot (pcf). This recommended value includes a factor of safety of approximately 1.5 which is appropriate due to the amount of movement required to develop full passive resistance.

### **Floor Slab Support**

In order to provide uniform subgrade reaction beneath concrete slab-on-grade floors, we recommend that the floor slab area be underlain by a minimum of 6 inches of free-draining (less than 5 percent passing the No. 200 sieve), well-graded, crushed rock. The crushed rock should help provide a capillary break to prevent migration of moisture through the slab. However, additional moisture protection can be provided by using a 10-mil polyolefin geo-membrane sheet such as StegoWrap.

The base course materials should be compacted to at least 95 percent of the maximum dry density as determined by the ASTM D-1557 (AASHTO T-180) test procedures. Where floor slab subgrade materials are undisturbed, firm and stable and where the underslab aggregate base rock section has been prepared and compacted as recommended above, we recommend that a modulus of subgrade reaction of 150 pci be used for design.

### **Retaining/Below Grade Walls**

Retaining and/or below grade walls should be designed to resist lateral earth pressures imposed by native soils or granular backfill materials as well as any adjacent surcharge loads. For walls which are unrestrained at the top and free to rotate about their base, we recommend that active earth pressures be computed on the basis of the following equivalent fluid densities:

**Non-Restrained Retaining Wall Pressure Design Recommendations**

<b>Slope Backfill (Horizontal/Vertical)</b>	<b>Equivalent Fluid Density/Silt (pcf)</b>	<b>Equivalent Fluid Density/Gravel (pcf)</b>
Level	35	30
3H:1V	60	50
2H:1V	90	80

For walls which are fully restrained at the top and prevented from rotation about their base, we recommend that at-rest earth pressures be computed on the basis of the following equivalent fluid densities:

**Restrained Retaining Wall Pressure Design Recommendations**

<b>Slope Backfill (Horizontal/Vertical)</b>	<b>Equivalent Fluid Density/Silt (pcf)</b>	<b>Equivalent Fluid Density/Gravel (pcf)</b>
Level	55	50
3H:1V	75	70
2H:1V	95	90

The above recommended values assume that the walls will be adequately drained to prevent the buildup of hydrostatic pressures. Where wall drainage will not be present and/or if adjacent surcharge loading is present, the above recommended values will be significantly higher. For seismic loading, we recommend an additional uniform pressure of 6H where H is the height of the wall in feet.

Backfill materials behind walls should be compacted to 90 percent of the maximum dry density as determined by the ASTM D-1557 (AASHTO T-180) test procedures. Special care should be taken to avoid over-compaction near the walls which could result in higher lateral earth pressures than those indicated herein. In areas within three (3) to five (5) feet behind walls, we recommend the use of hand-operated compaction equipment.

**Pavements**

Flexible pavement design for the proposed new public street improvements as well as the proposed new private drives and parking area improvements for The Views planned development was determined in accordance with the City of Sandy and/or Clackamas County Department of Public Works standards.

The subgrade soil samples collected at the site were tested in the laboratory in accordance with the ASTM Vol. 4.08 Part D-2844-69 (AASHTO T-190-93) test method for the determination of the subgrade soil "R"-value and expansion pressure. The results of the "R"-value testing was then converted to an equivalent Resilient Modulus ( $M_{RSG}$ ) in accordance with current AASHTO methodology. The results of the laboratory "R"-value tests revealed that the subgrade soils have an apparent "R"-value of between 29 and 31 with an average "R"-value of 30 (see Figure No. A-14).

Using the current AASHTO methodology for converting "R"-value to Resilient Modulus ( $M_{RSG}$ ), the subgrade soils have a Resilient Modulus ( $M_{RSG}$ ) of about 6,070 psi which is classified a "Fair" ( $M_{RSG} = 5,000$  psi to 10,000 psi). Based on the above, we recommend that the asphaltic concrete pavement section(s) for the new The Views planned development areas at the site consist of the following:

### **Collector Streets**

The following documents and/or design input parameters were used to help determine the flexible pavement section design for improvements to new and/or existing Collector Streets:

- . **Street Classification:** Collector Street
- . **Design Life:** 20 years
- . **Serviceability:** 4.2 initial, 2.5 terminal
- . **Traffic Loading Data:** 1,000,000 18-kip EAL's
- . **Reliability Level:** 90%
- . **Drainage Coefficient:** 1.0 (asphalt), 0.8 (aggregate)
- . **Asphalt Structural Coefficient:** 0.41
- . **Aggregate Structural Coefficient:** 0.10

Based on the above design input parameters and using the design procedures contained within the AASHTO 1993 Design of Pavement Structures Manual, a Structural Number (SN) of 4.1 was determined. In this regard, we recommend the following flexible pavement section for the new improvements to new and/or existing Collector Streets:

<b><u>Material Type</u></b>	<b><u>Pavement Section (inches)</u></b>
Asphaltic Concrete	5.0
Aggregate Base Rock	14.0

### **Local Residential Streets**

The following documents and/or design input parameters were used to help determine the flexible pavement section design for new local residential streets:

- . **Street Classification:** Local Residential Street
- . **Design Life:** 25 years
- . **Serviceability:** 4.2 initial, 2.5 terminal
- . **Traffic Loading Data:** 100,000 18-kip EAL's
- . **Reliability Level:** 90%
- . **Drainage Coefficient:** 1.0 (asphalt), 0.8 (aggregate)
- . **Asphalt Structural Coefficient:** 0.41
- . **Aggregate Structural Coefficient:** 0.10

Based on the above design input parameters and using the design procedures contained within the AASHTO 1993 Design of Pavement Structures Manual, a Structural Number (SN) of 2.6 was determined. In this regard, we recommend the following flexible pavement section for the construction of new Local Residential Streets:

<u>Material Type</u>	<u>Pavement Section (inches)</u>
Asphaltic Concrete	4.0
Aggregate Base Rock	10.0

**Private Access Drives and Parking Areas**

We recommend that the asphaltic concrete pavement section(s) for any private access drives and parking areas associated with The Views planned development areas consist of the following:

	<u>Asphaltic Concrete Thickness (inches)</u>	<u>Crushed Base Rock Thickness (inches)</u>
Automobile Parking Areas	3.0	8.0
Automobile Drive Areas	3.5	10.0

Note: Where heavy vehicle traffic is anticipated such as those required for fire and/or garbage trucks, we recommend that the automobile drive area pavement section be increased by adding 0.5 inches of asphaltic concrete and 2.0 inches of aggregate base rock. Additionally, the above recommended flexible pavement section(s) assumes a design life of 20 years.

**Pavement Subgrade, Base Course & Asphalt Materials**

The above recommended pavement section(s) were based on the design assumptions listed herein and on the assumption that construction of the pavement section(s) will be completed during an extended period of reasonably dry weather. All thicknesses given are intended to be the minimum acceptable. Increased base rock sections and the use of a woven geotextile fabric may be required during wet and/or inclement weather conditions and/or in order to adequately support construction traffic and protect the subgrade during construction. Additionally, the above recommended pavement section(s) assume that the subgrade will be prepared as recommended herein, that the exposed subgrade soils will be properly protected from rain and construction traffic, and that the subgrade is firm and unyielding at the time of paving. Further, it assumes that the subgrade is graded to prevent any ponding of water which may tend to accumulate in the base course.

Pavement base course materials should consist of well-graded 1-1/2 inch and/or 3/4-inch minus crushed base rock having less than 5 percent fine materials passing the No. 200 sieve. The base course and asphaltic concrete materials should conform to the requirements set forth in the latest edition of the Oregon Department of Transportation, Standard Specifications for Highway Construction. The base course materials should be compacted to at least 95 percent of the maximum dry density as determined by the ASTM D-1557 (AASHTO T-180) test procedures. The asphaltic concrete paving materials should be compacted to at least 92 percent of the theoretical maximum density as determined by the ASTM D-2041 (Rice Gravity) test method.

### **Wet Weather Grading and Soft Spot Mitigation**

Construction of the proposed new paved site improvements is generally recommended during dry weather. However, during wet weather grading and construction, excavation to subgrade can proceed during periods of light to moderate rainfall provided that the subgrade remains covered with aggregate. A total aggregate thickness of 8- to 12-inches may be necessary to protect the subgrade soils from heavy construction traffic. Construction traffic should not be allowed directly on the exposed subgrade but only atop a sufficient compacted base rock thickness to help mitigate subgrade pumping. If the subgrade becomes wet and pumps, no construction traffic shall be allowed on the road alignment. Positive site drainage shall be maintained if site paving will not occur before the on-set of the wet season.

Depending on the timing for the project, any soft subgrade found during proof-rolling or by visual observations can either be removed and replaced with properly dried and compacted fill soils or removed and replaced with compacted crushed aggregate. However, and where approved by the Geotechnical Engineer, the soft area may be covered with a bi-axial geogrid and covered with compacted crushed aggregate.

### **Soil Shrink-Swell and Frost Heave**

The results of the laboratory "R"-value tests indicate that the native subgrade soils possess a low to moderate expansion potential. As such, the exposed subgrade soils should not be allowed to completely dry and should be moistened to near optimum moisture content (plus or minus 3 percent) at the time of the placement of the crushed aggregate base rock materials. Additionally, exposure of the subgrade soils to freezing weather may result in frost heave and softening of the subgrade. As such, all subgrade soils exposed to freezing weather should be evaluated and approved by the Geotechnical Engineer prior to the placement of the crushed aggregate base rock materials.

### **Excavation/Slopes**

Temporary excavations of up to about four (4) feet in depth may be constructed with near vertical inclinations. Temporary excavations greater than about four (4) feet but less than eight (8) feet should be excavated with inclinations of at least 1 to 1 (horizontal to vertical) or properly braced/shored. Where excavations are planned to exceed about eight (8) feet, this office should be consulted.

All shoring systems and/or temporary excavation bracing for the project should be the responsibility of the excavation contractor. Permanent slopes should be constructed no steeper than about 2H to 1V unless approved by the Geotechnical Engineer.

Depending on the time of year in which trench excavations occur, trench dewatering may be required in order to maintain dry working conditions if the invert elevations of the proposed utilities are located at and/or below the groundwater level. If groundwater is encountered during utility excavation work, we recommend placing trench stabilization materials along the base of the excavation.


Trench stabilization materials should consist of 1-foot of well-graded gravel, crushed gravel, or crushed rock with a maximum particle size of 4 inches and less than 5 percent fines passing the No. 200 sieve. The material should be free of organic matter and other deleterious material and placed in a single lift and compacted until well keyed.

### **Surface Drainage/Groundwater**

We recommend that positive measures be taken to properly finish grade the site so that drainage waters from the residential structures and landscaping areas as well as adjacent properties or buildings are directed away from the new single-family residential structures foundations and/or floor slabs. All roof drainage should be directed into conduits that carry runoff water away from the residential structures to a suitable outfall. Roof downspouts should not be connected to foundation drains. A minimum ground slope of about 2 percent is generally recommended in unpaved areas around the proposed new residential structures.

Groundwater was not encountered at the site within any of the exploratory test pits excavated at the site at the time of excavation to depths of up to 7.0 feet beneath existing site grades. However, the central portion of the site contains an existing seasonal drainage basin. Further, groundwater elevations in the area and/or across the subject property may fluctuate seasonally and may temporarily pond/perch near the ground surface during periods of prolonged rainfall.

As such, based on our current understand of the possible site grading required to bring the subject site to finish design grade(s), we are of the opinion that an underslab drainage system is generally not required for the proposed single-family residential structures. However, a perimeter foundation drain is recommended for any perimeter footings and/or below grade retaining walls. A typical recommended perimeter footing/retaining wall drain detail is shown on Figure No. 4. Additionally, a subdrain is recommended beneath and/or within all structural fills which are constructed within and/or above the existing seasonal drainage basins.

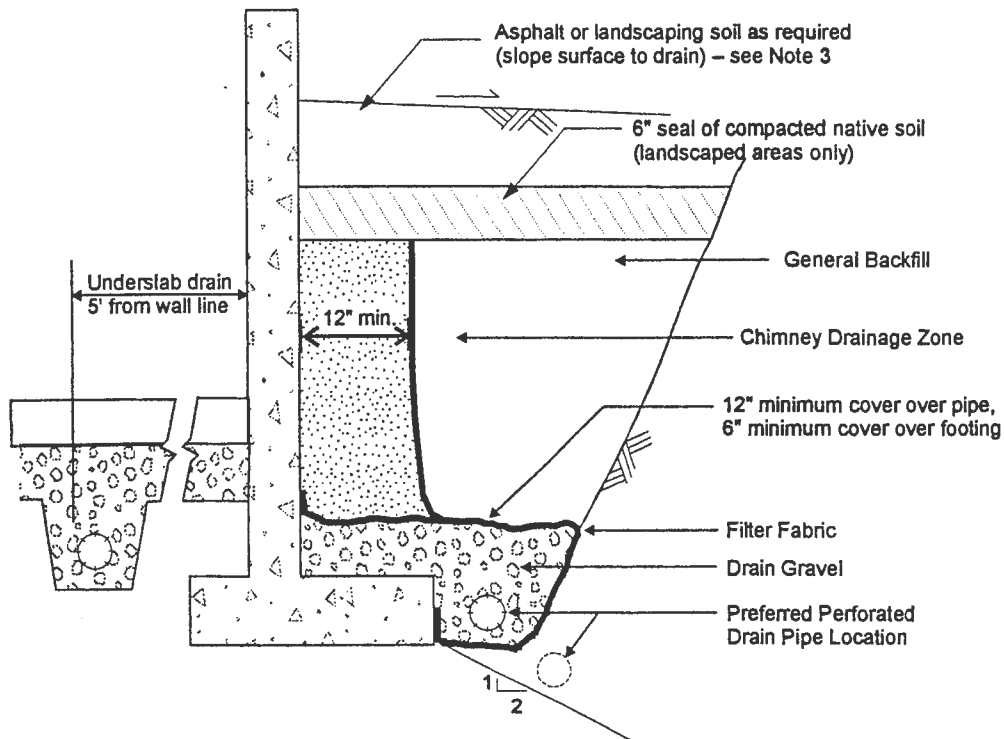

**SCHEMATIC - NOT TO SCALE**

**NOTES:**

1. Filter Fabric to be non-woven geotextile (Amoco 4545, Mirafi 140N, or equivalent)
2. Lay perforated drain pipe on minimum 0.5% gradient, widening excavation as required. Maintain pipe above 2:1 slope, as shown.
3. All-granular backfill is recommended for support of slabs, pavements, etc. (see text for structural fill).
4. Drain gravel to be clean, washed ¾" to 1½" gravel.
5. General backfill to be on-site gravels, or ¾"-0 or 1½"-0 crushed rock compacted to 92% Modified Proctor (AASHTO T-180).
6. Chimney drainage zone to be 12" wide (minimum) zone of clean washed, medium to coarse sand or drain gravel if protected with filter fabric. Alternatively, prefabricated drainage structures (Miradrain 6000 or similar) may be used.

**TYPICAL PERIMETER FOOTING/RETAINING WALL DRAIN DETAIL**

Project No. 1666.003.G

**THE BORNSTEDT VIEWS  
TL 100, SE BORNSTEDT ROAD**

Figure No. 4



Further, due to our understanding that various storm water detention and/or infiltration basins will be utilized for the project as well as the relatively low infiltration rates of the near surface sandy, clayey silt subgrade soils and/or highly weathered bedrock deposits anticipated within and/or near to the foundation bearing level of the proposed residential structures, we are generally of the opinion that storm water detention basins and/or infiltration systems should not be utilized around and/or up-gradient of the proposed residential structures unless approved by the Geotechnical Engineer.

### **Design Infiltration Rates**

Based on the results of our field infiltration testing, we recommend using the following infiltration rate to design any on-site near surface storm water infiltration and/or disposal systems for the project:

<b>Subgrade Soil Type</b>	<b>Recommended Infiltration Rate</b>
sandy, clayey SILT (ML)	less than 0.1 inches per hour (in/hr)

Note: A safety factor of two (2) was used to calculate the above recommended design infiltration rate. Additionally, given the gradational variability of the on-site sandy, clayey sit subgrade soils beneath the site as well as the anticipation of some site grading for the project, it is generally recommended that field testing be performed during and/or following construction of any on-site storm water infiltration system(s) in order to confirm that the above recommended design infiltration rates are appropriate.

### **Seismic Design Considerations**

Structures at the site should be designed to resist earthquake loading in accordance with the methodology described in the 2019 and/or latest edition of the State of Oregon Structural Specialty Code (OSSC), ASCE 7-16 and/or Amendments to the 2018 International Building Code (IBC). The maximum considered earthquake ground motion for short period and 1.0 period spectral response may be determined from the Oregon Structural Specialty Code and/or from the 2015 National Earthquake Hazard Reduction Program (NEHRP) "Recommended Provisions for Seismic Regulations for New Buildings and Other Structures" published by the Building Seismic Safety Council. We recommend Site Class "D" be used for design. Using this information, the structural engineer can select the appropriate site coefficient values ( $F_a$  and  $F_v$ ) from the 2018 IBC and/or ASCE 7-16 to determine the maximum considered earthquake spectral response acceleration for the project. However, we have assumed the following response spectrum for the project:

**Table 1. Recommended Seismic Design Parameters**

Site Class	S <sub>s</sub>	S <sub>1</sub>	F <sub>a</sub>	F <sub>v</sub>	S <sub>M5</sub>	S <sub>M1</sub>	S <sub>D5</sub>	S <sub>D1</sub>
D	0.702	0.314	1.239	1.986	0.867	0.6123	0.579	0.416

Notes: 1. S<sub>s</sub> and S<sub>1</sub> were established based on the ASCE 7-16 mapped maximum considered earthquake spectral acceleration maps for 2% probability of exceedence in 50 years.

2. F<sub>a</sub> and F<sub>v</sub> were established based on the ASCE 7-16 using the selected S<sub>s</sub> and S<sub>1</sub> values.

### **CONSTRUCTION MONITORING AND TESTING**

We recommend that **Redmond Geotechnical Services, LLC** be retained to provide construction monitoring and testing services during all earthwork operations for the proposed new The Bornstedt Views residential development. The purpose of our monitoring services would be to confirm that the site conditions reported herein are as anticipated, provide field recommendations as required based on the actual conditions encountered, document the activities of the grading contractor and assess his/her compliance with the project specifications and recommendations. It is important that our representative meet with the contractor prior to any site grading to help establish a plan that will minimize costly over-excavation and site preparation work. Of primary importance will be observations made during site preparation and stripping, structural fill placement, footing excavations and construction as well as retaining wall backfill.

### **CLOSURE AND LIMITATIONS**

This report is intended for the exclusive use of the addressee and/or their representative(s) to use to design and construct the proposed new single-family residential structures and their associated site improvements described herein as well as to prepare any related construction documents. The conclusions and recommendations contained in this report are based on site conditions as they presently exist and assume that the explorations are representative of the subsurface conditions between the explorations and/or at other locations across the study area. The data, analyses, and recommendations herein may not be appropriate for other structures and/or purposes. We recommend that parties contemplating other structures and/or purposes contact our office. In the absence of our written approval, we make no representation and assume no responsibility to other parties regarding this report. Additionally, the above recommendations are contingent on Redmond Geotechnical Services, LLC being retained to provide all site inspections and construction monitoring services for this project. Redmond Geotechnical Services, LLC will not assume any responsibility and/or liability for any engineering judgment, inspection and/or testing services performed by others.

It is the owners/developers responsibility for insuring that the project designers and/or contractors involved with this project implement our recommendations into the final design plans, specifications and/or construction activities for the project. Further, in order to avoid delays during construction, we recommend that the final design plans and specifications for the project be reviewed by our office to evaluate as to whether our recommendations have been properly interpreted and incorporated into the project.

If during any future site grading and construction, subsurface conditions different from those encountered in the explorations are observed or appear to be present beneath excavations, we should be advised immediately so that we may review these conditions and evaluate whether modifications of the design criteria are required. We also should be advised if significant modifications of the proposed site development are anticipated so that we may review our conclusions and recommendations.

### **LEVEL OF CARE**

The services performed by the Geotechnical Engineer for this project have been conducted with that level of care and skill ordinarily exercised by members of the profession currently practicing in the area under similar budget and time restraints. No warranty or other conditions, either expressed or implied, is made.

## REFERENCES

- Adams, John, 1984, Active Deformation of the Pacific Northwest Continental Margin: *Tectonics*, v.3, no. 4, p. 449-472.
- Applied Technology Council, ATC-13, 1985, Earthquake Damage Evaluation Data for California.
- Atwater, B.F., 1992, Geologic evidence for earthquakes during the past 2000 years along the Copalis River, southern coastal Washington: *Journal of Geophysical Research*, v. 97, p. 1901-1919.
- Atwater, B.F., 1987a, A periodic Holocene recurrence of widespread, probably coseismic Subsidence in southwestern Washington: *EOS*, v. 68, no. 44.
- Atwater, B.F., 1987b, Evidence for great Holocene earthquakes along the outer coast of Washington State: *Science*, v. 236, no. 4804, pp. 942-944.
- Campbell, K.W., 1990, Empirical prediction of near-surface soil and soft-rock ground motion for the Diablo Canyon Power Plant site, San Luis Obispo County, California: Dames & Moore report to Lawrence Livermore National Laboratory.
- Carver, G.A., and Burke, R.M., 1987, Late Holocene paleoseismicity of the southern end of the Cascadia Subduction zone [abs.]: *EOS*, v. 68, no. 44, p. 1240.
- Chase, R.L., Tiffin, D.L., Murray, J.W., 1975, The western Canadian continental margin: In Yorath, C.J., Parker, E.R., Glass, D.J., editors, *Canada's continental margins and offshore petroleum exploration: Canadian Society of Petroleum Geologists Memoir 4*, p. 701-721.
- Crouse, C.B., 1991a, Ground motion attenuation equations for earthquakes on the Cascadia Subduction Zone: *Earthquake Spectra*, v. 7, no. 2, pp. 201-236.
- Crouse, C.B., 1991b, Errata to Crouse (1991a), *Earthquake Spectra*, v. 7, no. 3, p. 506.
- Dariento, M.E., and Peterson, C.D., 1987, Episodic tectonic subsidence recorded in late Holocene salt marshes, northern Oregon central Cascadia margin: *Tectonics*, v. 9, p. 1-22.
- Dariento, M.E., and Peterson, C.D., 1987, Episodic tectonic subsidence recorded in late Holocene salt marshes northwest Oregon [abs]: *EOS*, v. 68, no. 44, p. 1469.
- EERI (Earthquake Engineering Research Institute), 1993, The March 25, 1993, Scotts Mill Earthquake, Western Oregon's Wake-Up Call: *EERI Newsletter*, Vol. 27, No. 5, May.
- Geomatrix, 1995 Seismic Design Mapping, State of Oregon: Final Report to Oregon Department of Transportation, January.

Geologic Map Series (GMS-49), Map of Oregon Seismicity, 1841-1986 dated 1986.

Geologic Map Series (GMS-97), Geologic Map of the Damascus Quadrangle, Clackamas County, Oregon dated 1995.

Grant, W.C., and McLaren, D.D., 1987, Evidence for Holocene Subduction earthquakes along the northern Oregon coast [abs]: EOS v. 68, no. 44, p. 1239.

Grant, W.C., Atwater, B.F., Carver, G.A., Darienzo, M.E., Nelson, A.R., Peterson, C.D., and Vick, G.S., 1989, Radiocarbon dating of late Holocene coastal subsidence above the Cascadia Subduction zone-compilation for Washington, Oregon, and northern California, [abs]: EOS Transactions of the American Geophysical Union, v. 70, p. 1331.

International Conference of Building Officials (ICBO), 1994, Uniform Building Code: 1994 Edition, Whittier, CA. 1994.

Joyner, W.B., and Boore, D.M., 1998, Measurement, characterization and prediction of strong ground motion: Earthquake Engineering and Soil Dynamics II – Recent Advances in Ground Motion Evaluation, ASCE Geotech. Special Publ. No. 20, p. 43-102.

Riddihough, R.P., 1984, Recent movements of the Juan de Fuca plate system: Journal of Geophysical Research, v. 89, no. B8, p. 6980-6994.

Youngs, R.R., Day, S.M., and Stevens, J.L., 1998, Near field ground motions on rock for large Subduction earthquakes: Earthquake Engineering and Soil Dynamics II – Recent Advances in Ground Motion Evaluation, ASCE Geotech. Special Publ. No. 20, p. 445-462.

# **Appendix "A"**

---

**Test Pit Logs and Laboratory Test Data**

## **APPENDIX**

### **FIELD EXPLORATIONS AND LABORATORY TESTING**

#### **FIELD EXPLORATION**

Subsurface conditions at the site were explored by excavating ten (10) exploratory test pits (TH-#1 through TH-#10) on October 1, 2020. The approximate location of the test pit explorations are shown in relation to the existing site features and/or site improvements on the Site Exploration Plan, Figure No. 2.

The test pits were excavated using Geoprobe excavating equipment in general conformance with ASTM Methods in Vol. 4.08, D-1586-94 and D-1587-83. The test pits were excavated to depths ranging from about 5.0 to 7.0 feet beneath existing site grades. Detailed logs of the test pits are presented on the Log of Test Pits, Figure No's. A-4 through A-8. The soils were classified in accordance with the Unified Soil Classification System (USCS), which is outlined on Figure No. A-3.

The exploration program was coordinated by a field engineer who monitored the excavating and exploration activity, obtained representative samples of the subsurface soils encountered, classified the soils by visual and textural examination, and maintained continuous logs of the subsurface conditions. Disturbed and/or undisturbed samples of the subsurface soils were obtained at appropriate depths and/or intervals and placed in plastic bags and/or with a thin walled ring sample.

Groundwater was not encountered within any of the exploratory test pits (TH-#1 through TH-#10) at the time of excavating to depths of up to 7.0 feet beneath existing surface grades.

#### **LABORATORY TESTING**

Pertinent physical and engineering characteristics of the soils encountered during our subsurface investigation were evaluated by a laboratory testing program to be used as a basis for selection of soil design parameters and for correlation purposes. Selected tests were conducted on representative soil samples. The program consisted of tests to evaluate the existing (in-situ) moisture-density, maximum dry density and optimum moisture content, Atterberg Limits and gradational characteristics as well as direct shear strength and "R"-value tests.

##### **Dry Density and Moisture Content Determinations**

Density and moisture content determinations were performed on both disturbed and relatively undisturbed samples from the test pit explorations in general conformance with ASTM Vol. 4.08 Part D-216. The results of these tests were used to calculate existing overburden pressures and to correlate strength and compressibility characteristics of the soils. Test results are shown on the test pit logs at the appropriate sample depths.

### **Maximum Dry Density**

Two (2) Maximum Dry Density and Optimum Moisture Content tests were performed on representative samples of the on-site sandy, clayey silt subgrade soils in accordance with ASTM Vol. 4.08 Part D-1557. This test was conducted to help establish various engineering properties for use as structural fill. The test results are presented on Figure No. A-9.

### **Atterberg Limits**

Two (2) Liquid Limit (LL) and Plastic Limit (PL) tests were performed on representative samples of the sandy, clayey silt subgrade soils in accordance with ASTM Vol. 4.08 Part D-4318-85. These tests were conducted to facilitate classification of the soils and for correlation purposes. The test results appear on Figure No. A-10.

### **Gradation Analysis**

Two (2) Gradation analyses were performed on representative samples of the sandy, clayey silt subsurface soils in accordance with ASTM Vol. 4.08 Part D-422. The test results were used to classify the soil in accordance with the Unified Soil Classification System (USCS). The test results are shown graphically on Figure No. A-11.

### **Direct Shear Strength Test**

One (1) Direct Shear Strength test was performed on a undisturbed and/or remolded sample of the sandy, clayey silt to silty clay subgrade soils at a continuous rate of shearing deflection (0.02 inches per minute) in accordance with ASTM Vol. 4.08 Part D-3080-79. The test results were used to determine engineering strength properties and are shown graphically on Figure No's. A-12.

### **"R"-Value Tests**

Two (2) "R"-value tests were performed on remolded samples of the sandy, clayey silt subgrade soils in accordance with ASTM Vol. 4.08 Part D-2844. The test results were used to help evaluate the subgrade soils supporting and performance capabilities when subjected to traffic loading. The test results are shown on Figure No. A-13.

The following figures are attached and complete the Appendix:

Figure No. A-3  
Figure No's. A-4 through A-8  
Figure No. A-9  
Figure No. A-10  
Figure No. A-11  
Figure No. A-12  
Figure No. A-13  
Figure No's. A-14 and A-14

Key To Exploratory Test Pit Logs  
Log of Test Pits  
Maximum Dry Density  
Atterberg Limits Test Results  
Gradation Test Results  
Direct Shear Strength Test Results  
Results of "R"-Value Tests  
Field Infiltration Test Results



PRIMARY DIVISIONS			GROUP SYMBOL	SECONDARY DIVISIONS
COARSE GRAINED SOILS MORE THAN HALF OF MATERIAL IS LARGER THAN NO. 200 SIEVE SIZE	GRAVELS MORE THAN HALF OF COARSE FRACTION IS LARGER THAN NO. 4 SIEVE	CLEAN GRAVELS (LESS THAN 5% FINES)	GW	Well graded gravels, gravel-sand mixtures, little or no fines.
			GP	Poorly graded gravels or gravel-sand mixtures, little or no fines.
		GRAVEL WITH FINES	GM	Silty gravels, gravel-sand-silt mixtures, non-plastic fines.
			GC	Clayey gravels, gravel-sand-clay mixtures, plastic fines.
	SANDS MORE THAN HALF OF COARSE FRACTION IS SMALLER THAN NO. 4 SIEVE	CLEAN SANDS (LESS THAN 5% FINES)	SW	Well graded sands, gravelly sands, little or no fines.
			SP	Poorly graded sands or gravelly sands, little or no fines.
		SANDS WITH FINES	SM	Silty sands, sand-silt mixtures, non-plastic fines.
			SC	Clayey sands, sand-clay mixtures, plastic fines.
FINE GRAINED SOILS MORE THAN HALF OF MATERIAL IS SMALLER THAN NO. 200 SIEVE SIZE	SILTS AND CLAYS  LIQUID LIMIT IS LESS THAN 50%		ML	Inorganic silts and very fine sands, rock flour, silty, or clayey fine sands or clayey silts with slight plasticity.
			CL	Inorganic clays of low to medium plasticity, gravelly clays, sandy clays, silty clays, lean clays.
			OL	Organic silts and organic silty clays of low plasticity.
	SILTS AND CLAYS  LIQUID LIMIT IS GREATER THAN 50%		MH	Inorganic silts, micaceous or diatomaceous fine sandy or silty soils, elastic silts.
			CH	Inorganic clays of high plasticity, fat clays.
			OH	Organic clays of medium to high plasticity, organic silts.
HIGHLY ORGANIC SOILS			Pt	Peat and other highly organic soils.

**DEFINITION OF TERMS**

		U.S. STANDARD SERIES SIEVE			CLEAR SQUARE SIEVE OPENINGS					
		200	40	10	4	3/4"	3"	12"		
SILTS AND CLAYS	SAND			GRAVEL		COBBLES	BOULDERS			
	FINE	MEDIUM	COARSE	FINE	COARSE					

**GRAIN SIZES**

SANDS, GRAVELS AND NON-PLASTIC SILTS	BLOWS/FOOT †
VERY LOOSE	0 - 4
LOOSE	4 - 10
MEDIUM DENSE	10 - 30
DENSE	30 - 50
VERY DENSE	OVER 50

CLAYS AND PLASTIC SILTS	STRENGTH ‡	BLOWS/FOOT †
VERY SOFT	0 - 1/4	0 - 2
SOFT	1/4 - 1/2	2 - 4
FIRM	1/2 - 1	4 - 8
STIFF	1 - 2	8 - 16
VERY STIFF	2 - 4	16 - 32
HARD	OVER 4	OVER 32

**RELATIVE DENSITY**

† Number of blows of 140 pound hammer falling 30 inches to drive a 2 inch O.D. (1-3/8 inch I.D.) split spoon (ASTM D-1586).

‡ Unconfined compressive strength in tons/sq. ft. as determined by laboratory testing or approximated by the standard penetration test (ASTM D-1586), pocket penetrometer, torvane, or visual observation.

**CONSISTENCY**

**KEY TO EXPLORATORY TEST PIT LOGS  
Unified Soil Classification System (ASTM D-2487)**

THE BORNSTEDT VIEWS  
TL 100, SE Bornsteddy Road

PROJECT NO.	DATE	Figure
1666.003.G	10/26/20	



PO Box 20547 • PORTLAND, OREGON 97294

DEPTH (FEET)	BAG SAMPLE	DENSITY TEST	DRY DENSITY (pcf)	MOISTURE CONTENT (%)	SOIL CLASS. (U.S.C.S.)	SOIL DESCRIPTION
						TEST PIT NO. TH-#1 ELEVATION 1,025'±
0					ML	Dark brown, wet, soft, organic, sandy, clayey SILT (Topsoil)
X				36.6	ML/CL	Reddish-brown, very moist to wet, soft to medium stiff, sandy, clayey SILT to silty CLAY (Residual Soil)
5	X			30.9	ML/RK	Light reddish- to orangish-brown, very moist, very stiff to dense, sandy, clayey SILT to highly weathered bedrock
						Total Depth = 6.0 feet No groundwater encountered at time of exploration

						TEST PIT NO. TH-#2 ELEVATION 1,030'±
0					ML	Dark brown, wet, soft, organic, sandy, clayey SILT (Topsoil)
X				38.8	ML/CL	Reddish-brown, very moist to wet, soft to medium stiff, sandy, clayey SILT to silty CLAY (Residual Soil)
5						Total Depth = 6.0 feet No groundwater encountered at time of exploration

**LOG OF TEST PITS**

BACKHOE COMPANY: Inland Company

BUCKET SIZE: 6 inches

DATE: 10/01/20

DEPTH (FEET)	BAG SAMPLE	DENSITY TEST	DRY DENSITY (pcf)	MOISTURE CONTENT (%)	SOIL CLASS. (U.S.C.S.)	SOIL DESCRIPTION	
						TEST PIT NO.	ELEVATION
0					ML	TH-#3	1,000'±
					ML		
	X			37.1	ML/CL		
5					ML/RK		
10							
15							

Dark brown, wet, soft, organic, sandy, clayey SILT (Topsoil)

Reddish-brown, very moist to wet, soft to medium stiff, sandy, clayey SILT to silty CLAY (Residual Soil)

Light reddish- to orangish-brown, very moist, very stiff to dense, sandy, clayey SILT to highly weathered bedrock

Total Depth = 7.0 feet  
No groundwater encountered at time of exploration

						TEST PIT NO.	ELEVATION
						TH-#4	995'±
0					ML		
					ML/CL		
5							
10							
15							

Dark brown, wet, soft, organic, sandy, clayey SILT (Topsoil)

Reddish-brown, very moist to wet, soft to medium stiff, sandy, clayey SILT to silty CLAY (Residual Soil)

Total Depth = 5.0 feet  
No groundwater encountered at time of exploration

**LOG OF TEST PITS**

PROJECT NO. 1666.003.G

THE BORNSTEDT VIEWS

FIGURE NO. A-5

BACKHOE COMPANY: Inland Company

BUCKET SIZE: 6 inches

DATE: 10/01/20

DEPTH (FEET)	BAG SAMPLE	DENSITY TEST	DRY DENSITY (pcf)	MOISTURE CONTENT (%)	SOIL CLASS. (U.S.C.S.)	SOIL DESCRIPTION
						TEST PIT NO. TH-#5 ELEVATION 1,035'±
0					ML	Dark brown, wet, soft, organic, sandy, clayey SILT (Topsoil)
5					ML/CL	Reddish-brown, very moist to wet, soft to medium stiff, sandy, clayey SILT to silty CLAY (Residual Soil)
10						Total Depth = 6.0 feet No groundwater encountered at time of exploration
15						

						TEST PIT NO. TH-#6 ELEVATION 1,035'±
0					ML	Dark brown, wet, soft, organic, sandy, clayey SILT (Topsoil)
5	X			36.9	M: / CL	Reddish-brown, very moist to wet, soft to medium stiff, sandy, clayey SILT to silty CLAY (Residual Soil)
10					ML/RK	Light reddish- to orangish-brown, very moist, very stiff to dense, sandy, clayey SILT to highly weathered bedrock
15						Total Depth = 7.0 feet No groundwater encountered at time of exploration

**LOG OF TEST PITS**

PROJECT NO. 1666.003.G

THE BORNSTEDT VIEWS

FIGURE NO. A-6

BACKHOE COMPANY: Inland Company

BUCKET SIZE: 6 inches

DATE: 10/01/20

DEPTH (FEET)	BAG SAMPLE	DENSITY TEST	DRY DENSITY (pcf)	MOISTURE CONTENT (%)	SOIL CLASS. (U.S.C.S.)	SOIL DESCRIPTION
						TEST PIT NO. TH-#7 ELEVATION 1,025'±
0					ML	Dark brown, wet, soft, organic, sandy, clayey SILT (Topsoil)
					ML/CL	Reddish-brown, very moist to wet, soft to medium stiff, sandy, clayey SILT to silty CLAY (Residual Soil)
5						Total Depth = 5.0 feet No groundwater encountered at time of exploration
10						
15						

						TEST PIT NO. TH-#8 ELEVATION 1,020'±
0					ML	Dark brown, wet, soft, organic, sandy, clayey SILT (Topsoil)
	X			39.5	ML/CL	Reddish-brown, very moist to wet, soft to medium stiff, sandy, clayey SILT to silty CLAY (Residual Soil)
5						Total Depth = 7.0 feet No groundwater encountered at time of exploration
	X			38.8	ML/RK	Light reddish-to orangish-brown, very moist, very stiff to dense, sandy, clayey SILT to highly weathered bedrock
10						
15						

**LOG OF TEST PITS**

PROJECT NO. 1666.003,G	THE BORNSTEDT VIEWS	FIGURE NO. A-7
------------------------	---------------------	----------------

BACKHOE COMPANY: Inland Company

BUCKET SIZE: 6 inches

DATE: 10/01/20

DEPTH (FEET)	BAG SAMPLE	DENSITY TEST	DRY DENSITY (pcf)	MOISTURE CONTENT (%)	SOIL CLASS. (U.S.C.S.)	SOIL DESCRIPTION
						TEST PIT NO. TH-#9 ELEVATION 1,015'±
0					ML	Dark brown, wet, soft, organic, sandy, clayey SILT (Topsoil)
	X			38.0	ML/CL	Reddish-brown, very moist to wet, soft to medium stiff, sandy, clayey SILT to silty CLAY (Residual Soil)
5					ML/RK	Light reddish to orangish-brown, very moist, very stiff to dense, sandy, clayey SILT to highly weathered bedrock
						Total Depth = 6.0 feet No groundwater encountered at time of exploration

						TEST PIT NO. TH-#10 ELEVATION 1,010'±
0					ML	Dark brown, wet, soft, organic, sandy, clayey SILT (Topsoil)
					ML/CL	Reddish-brown, very moist to wet, soft to medium stiff, sandy, clayey SILT to silty CLAY (Residual Soil)
5						Total Depth = 5.0 feet No groundwater encountered at time of exploration

**LOG OF TEST PITS**

PROJECT NO. 1666.003.G

THE BORNSTEDT VIEWS

FIGURE NO. A-8

**MAXIMUM DENSITY TEST RESULTS**


SAMPLE LOCATION	SOIL DESCRIPTION	MAXIMUM DRY DENSITY (pcf)	OPTIMUM MOISTURE CONTENT (%)
TH-#1 @ 2.0'	Reddish-brown, sandy, clayey SILT to silty CLAY (ML/CL)	100.0	34.0
TH-#6 @ 2.0'	Reddish-brown, sandy, clayey SILT to silty CLAY (ML/CL)	99.0	35.0

**EXPANSION INDEX TEST RESULTS**

SAMPLE LOCATION	INITIAL MOISTURE (%)	COMPACTED DRY DENSITY (pcf)	FINAL MOISTURE (%)	VOLUMETRIC SWELL (%)	EXPANSION INDEX	EXPANSIVE CLASS.

**MAXIMUM DENSITY & EXPANSION INDEX TEST RESULTS**

PROJECT NO. 1666.003.G	THE BORNSTEDT VIEWS	FIGURE NO.: A-9
------------------------	---------------------	-----------------

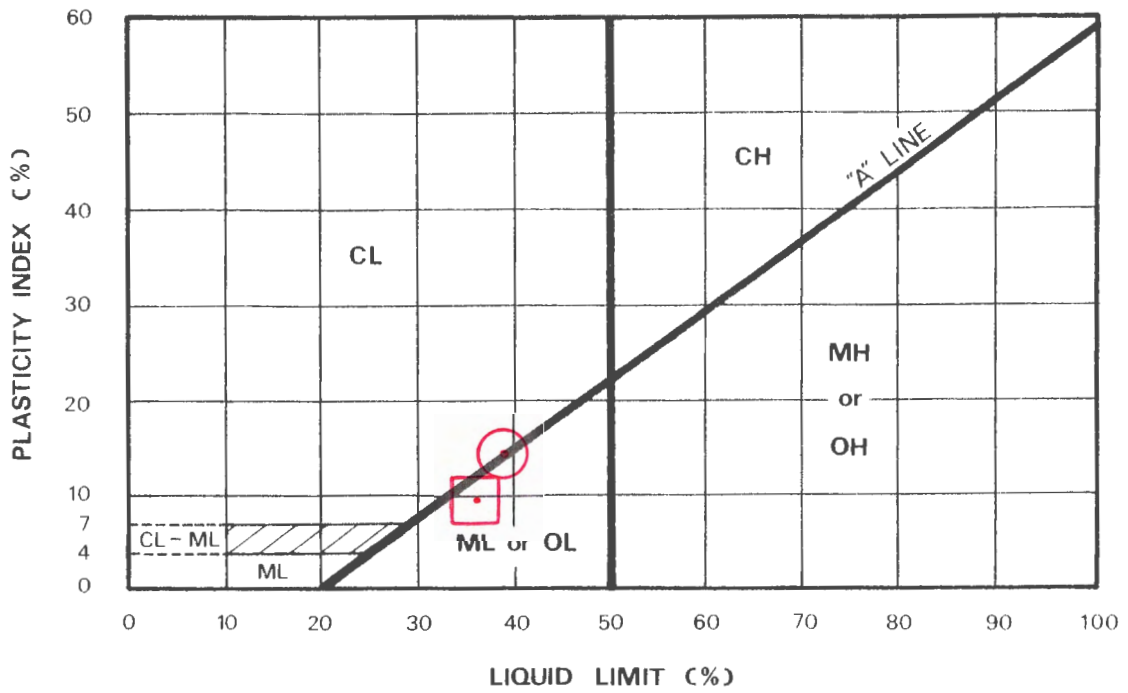

KEY SYMBOL	BORING NO.	SAMPLE DEPTH (feet)	NATURAL WATER CONTENT %	LIQUID LIMIT %	PLASTICITY INDEX %	PASSING NO. 200 SIEVE %	LIQUIDITY INDEX	UNIFIED SOIL CLASSIFICATION SYMBOL
	TH-#1	2.0	36.6	36.1	9.9	85.1		ML/CL
	TH-#6	2.0	36.9	39.4	14.2	90.3		ML/CL



THE BORNSTEDT VIEWS  
PLASTICITY CHART AND DATA


THE BORNSTEDT VIEWS  
TL 100, SE Bornstedt Road

PROJECT NO.	DATE	Figure A-10
1666.003.G	10/26/20	



# UNIFIED SOIL CLASSIFICATION SYSTEM

(ASTM D 422-72)

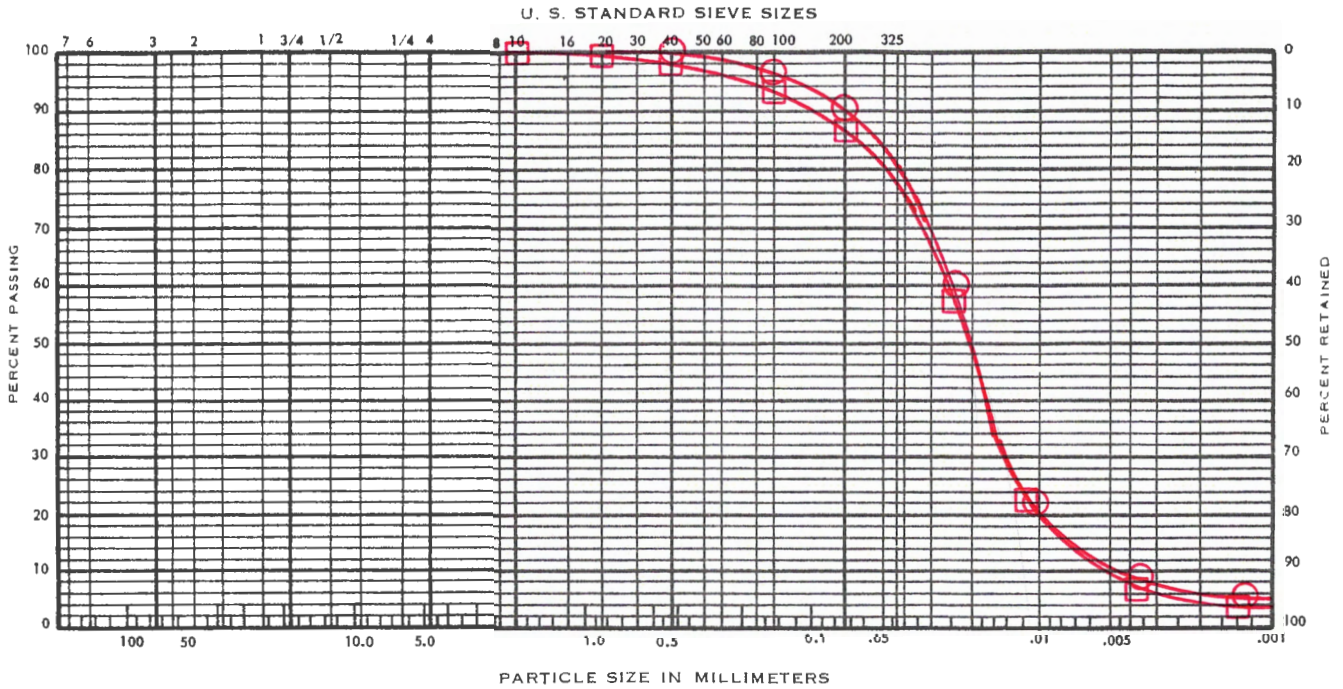

COBBLES	GRAVEL		SAND			SILT AND CLAY
	COARSE	FINE	COARSE	MEDIUM	FINE	

KEY SYMBOL	BORING NO.	SAMPLE DEPTH (feet)	ELEV. (feet)	UNIFIED SOIL CLASSIFICATION SYMBOL	SAMPLE DESCRIPTION
☐	TH-#1	2.0		ML/CL	Reddish-brown, sandy, clayey SILT to silty CLAY
○	TH-#6	2.0		ML/CL	Reddish-brown, sandy, clayey SILT to silty CLAY



PO Box 20547 • PORTLAND, OREGON 97294

### GRADATION TEST DATA

THE BORNSTEDT VIEWS  
TL 1000, SE Bornstedt Road


PROJECT NO.

DATE

FIGURE A-11

1666.003.G

10/26/20

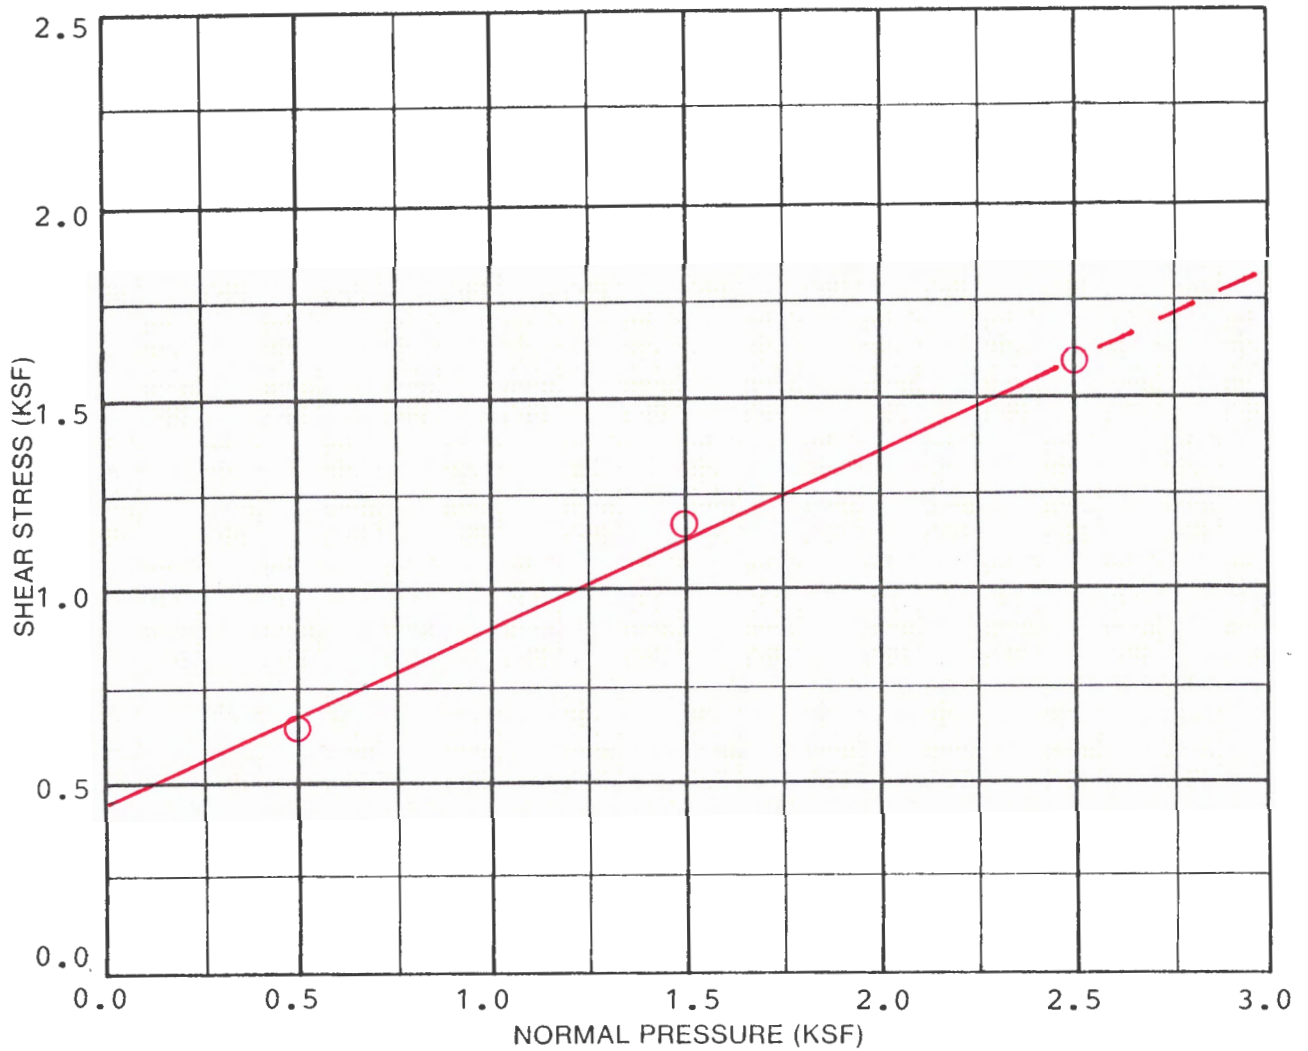

SAMPLE DATA	
DESCRIPTION: Reddish-brown, sandy, clayey SILT to silty CLAY (ML/CL) (Remolded)	
BORING NO.: TH-#1	
DEPTH (ft.): 2.0	ELEVATION (ft.):
TEST RESULTS	
APPARENT COHESION (C): 450 psf	
APPARENT ANGLE OF INTERNAL FRICTION ( $\phi$ ): 24°	

TEST DATA				
TEST NUMBER	1	2	3	4
NORMAL PRESSURE (KSF)	0.5	1.5	2.5	
SHEAR STRENGTH (KSF)	0.6	1.1	1.6	
INITIAL H <sub>2</sub> O CONTENT (%)	34.0	34.0	34.0	
FINAL H <sub>2</sub> O CONTENT (%)	35.1	29.5	23.3	
INITIAL DRY DENSITY (PCF)	92.0	92.0	92.0	
FINAL DRY DENSITY (PCF)	92.8	95.5	99.7	
STRAIN RATE: 0.02 inches per minute				



**REDMOND  
GEOTECHNICAL  
SERVICES**

PO Box 20547 • PORTLAND, OREGON 97294

**DIRECT SHEAR TEST DATA**

THE BORNSTEDT VIEWS  
TL 100, SE Bornstedt Road

PROJECT NO.	DATE
1666.003.G	10/26/20

Figure A-12

## RESULTS OF R (RESISTANCE) VALUE TESTS

**SAMPLE LOCATION: TH-#1**

**SAMPLE DEPTH: 2.0 feet bgs**

Specimen	A	B	C
Exudation Pressure (psi)	219	329	431
Expansion Dial (0.0001")	0	1	2
Expansion Pressure (psf)	0	3	8
Moisture Content (%)	37.6	34.4	31.1
Dry Density (pcf)	92.4	96.2	100.6
Resistance Value, "R"	18	29	36
"R"-Value at 300 psi Exudation Pressure = 28			

**SAMPLE LOCATION: TH-#6**

**SAMPLE DEPTH: 2.0 feet bgs**

Specimen	A	B	C
Exudation Pressure (psi)	208	326	439
Expansion Dial (0.0001")	0	1	2
Expansion Pressure (psf)	0	3	8
Moisture Content (%)	37.2	34.1	30.7
Dry Density (pcf)	92.9	97.1	101.4
Resistance Value "R"	19	31	40
"R"-Value at 300 psi Exudation Pressure = 30			

## Division 004 Appendix C - Infiltration Testing

<b>Location:</b> The Bornstedt Views	<b>Date:</b> October 1, 2020	<b>Test Hole:</b> TH-#4
<b>Depth to Bottom of Hole:</b> 4.0 feet	<b>Hole Diameter:</b> 6 inches	<b>Test Method:</b> Encased Falling Head
<b>Tester's Name:</b> Daniel M. Redmond, P.E., G.E.		
<b>Tester's Company:</b> Redmond Geotechnical Services, LLC		<b>Tester's Contact Number:</b> 503-285-0598
<b>Depth (feet)</b>	<b>Soil Characteristics</b>	
0-1.0	Dark brown Topsoil	
1.0-4.0	Reddish-brown, sandy, clayey SILT to silty CLAY (ML/CL)	

Time	Time Interval (Minutes)	Measurement (inches)	Drop in Water (inches)	Infiltration Rate (inches/hour)	Remarks
11:00	0	48.00	----		Filled w/12" water
11:20	20	48.20	0.20	0.60	
11:40	20	48.34	0.14	0.42	
12:00	20	48.45	0.11	0.33	
12:20	20	48.54	0.09	0.27	
12:40	20	48.62	0.08	0.24	
1:00	20	48.69	0.07	0.21	
1:20	20	48.76	0.07	0.21	
1:40	20	48.83	0.07	0.21	

Infiltration Test Data Table

**Division 004 Appendix C - Infiltration Testing**

<b>Location:</b> The Bornstedt Views	<b>Date:</b> October 1, 2020	<b>Test Hole:</b> TH-#10
<b>Depth to Bottom of Hole:</b> 5.0 feet	<b>Hole Diameter:</b> 6 inches	<b>Test Method:</b> Encased Falling Head
<b>Tester's Name:</b> Daniel M. Redmond, P.E., G.E.		
<b>Tester's Company:</b> Redmond Geotechnical Services, LLC		<b>Tester's Contact Number:</b> 503-285-0598
<b>Depth (feet)</b>	<b>Soil Characteristics</b>	
0-1.0	Dark brown Topsoil	
1.0-5.0	Reddish-brown, sandy, clayey SILT to silty CLAY (ML/CL)	

Time	Time Interval (Minutes)	Measurement (inches)	Drop in Water (inches)	Infiltration Rate (inches/hour)	Remarks
11:30	0	60.00	----		Filled w/12" water
11:50	20	60.15	0.15	0.45	
12:10	20	60.25	0.10	0.30	
12:30	20	60.32	0.07	0.21	
12:50	20	60.37	0.05	0.15	
1:10	20	60.41	0.04	0.12	
1:30	20	60.44	0.03	0.09	
1:50	20	60.47	0.03	0.09	
2:10	20	60.50	0.03	0.09	

Infiltration Test Data Table